


Below is a list of some basic installation requirements and recommendations that your contractor should meet when installing a radon reduction system in your home. If you would like a full copy of the radon mitigation standards, please contact the S.C. Department of Health and Environmental Control (DHEC).

- Contractor should be certified for radon mitigation (radon proficiency programs include National Radon Safety Board or American Association of Radio Scientists and Technologists' National Radon Proficiency Program). *Note: it is the individual who is certified, not the company.*
- Contractor should conduct diagnostic tests depending on specifics of the house such as the foundation design and material under the house.
- If combustion appliances are present, contractor should conduct back-drafting testing. If spillage is found, active mitigation cannot be installed until corrected.
- Radon reduction system must be clearly labeled. This will avoid accidental changes to the system.
- The sealing and/or caulking around the vent pipe in the basement or slab floor must be intact.
- Vent pipe and utility penetrations in slab, walls, or soil gas retarder must be permanently sealed (air tight).
- Wall-floor joint must be sealed; contractor should seal other slab openings, cracks, or joints.
- If reducing radon in a crawlspace, the vapor barrier (soil-gas-retarder, e.g., polyethylene) must extend to the foundation walls, and the seams must be overlapped by at least 12". Contractor should seal around interior piers and to perimeter walls.
- If the crawlspace depressurization method is used, openings to conditioned space must be closed and sealed.
- Pipe must be adequately secured to the structure, not to existing pipe, ducts, or mechanical equipment.
- Horizontal pipe must be supported every 6 feet; vertical pipe not penetrating partitions every 8 feet must be supported.
- Pipe, fittings and connections must be air tight and properly joined and sealed.
- The exhaust pipe(s) must vent above the roof eave and 10 feet or more above ground. It must also vent at least 10 feet away from windows, doors, or other openings into house or adjacent building, or at least 2 feet above any such openings.
- Electrical connections must be installed according to federal and local codes.
- Radon vent fan must not be located in or below a livable area. (For example, in an unoccupied attic or outside is acceptable - not in a basement!).
- If the fan is mounted outdoors, a fan rated for outdoor use or enclosed watertight housing must be used.
- The fan must be installed with removable or flexible couplings.
- A plugged cord must not be longer than 6 feet.
- Outdoor fan, if used, must be hard-wired; do not use plug-in connections. If fan is hard-wired, electrical disconnect switch or breaker must be installed for fan maintenance and labeled "Radon System."
- Warning device must be installed to alert you if an active system stops working. Examples include: U-Tube manometer (a liquid gauge), a sound alarm or light indicator. The warning device must be placed where it can be seen or heard easily.
- If pressurizing is the method of mitigation, removable screens or filters in in-take must be used and owner must be advised of need for cleaning or replacement. This must also be included as information in documentation.
- Contractor completely explains your radon reduction system, demonstrates how it operates and explains how to maintain it.
- A post mitigation radon test must be performed. The test should be done within 30 days of system installation, but no sooner than 24 hours after the system is in operation.

Radon Mitigation

Home Diagram

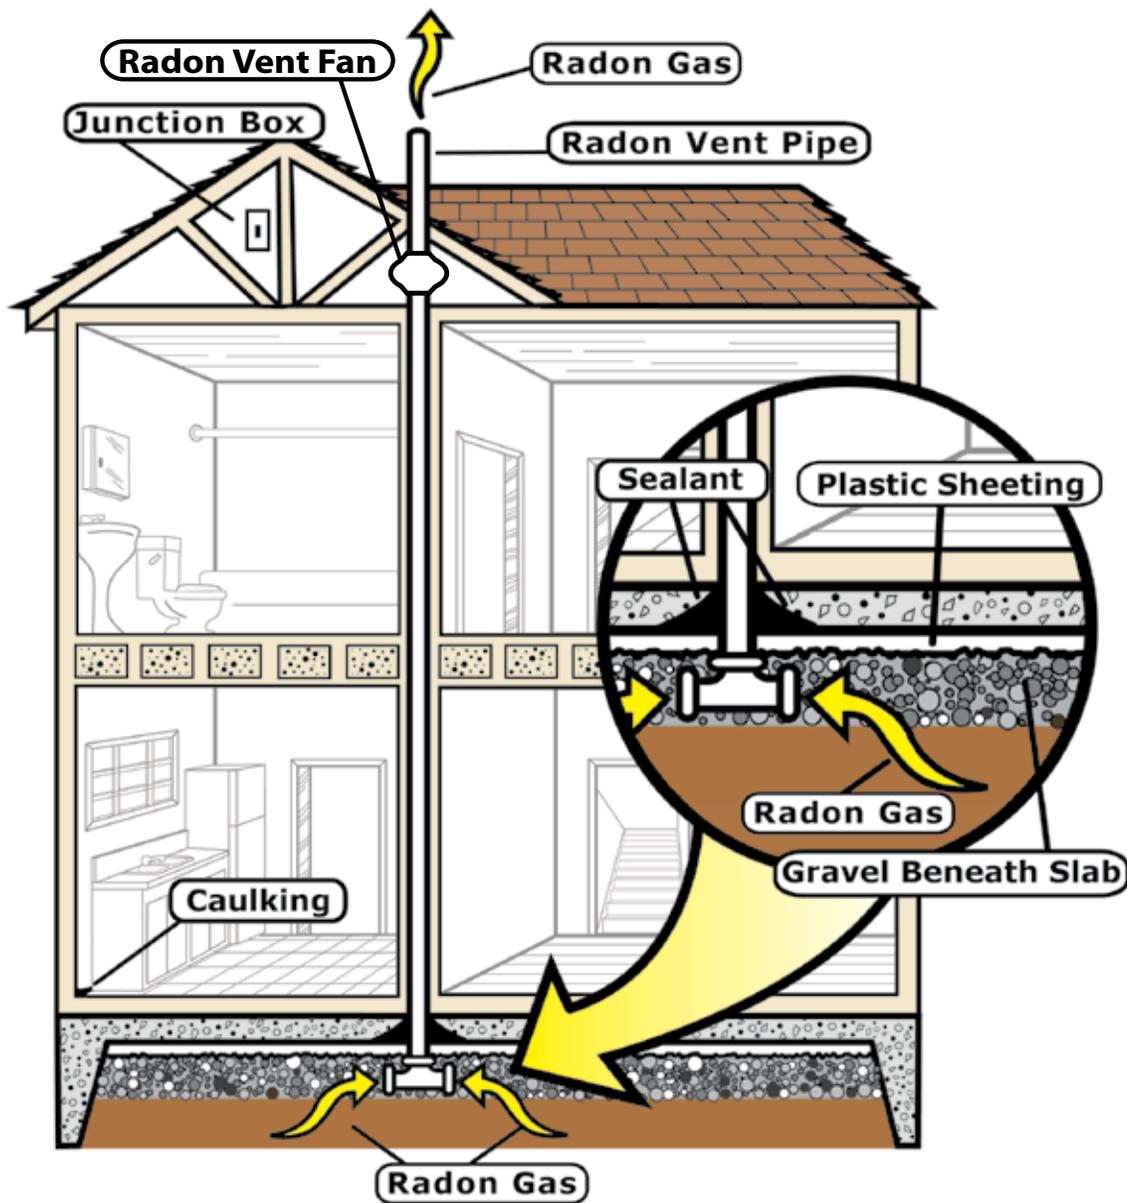

Note: This diagram is a general view of a subslab depressurization system. Not all homes will have gravel or a soil gas retainer beneath the slab. The pipe may also be installed on the outside of the home.

Illustration provided by the EPA



For more information contact:

S.C. Department of Health and Environmental Control (DHEC)

Phone: 1-800-768-0362

Email: radon@dhec.sc.gov

Website: www.scdhec.gov/radon